



CENTRAL TERMICA DE MOLLENDO 13,8 KV

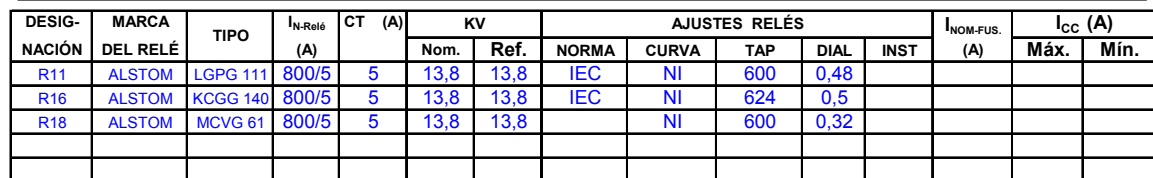

FALLA FASE A TIERRA
CENTRAL TERMICA MOLLEND0 13,8 KV

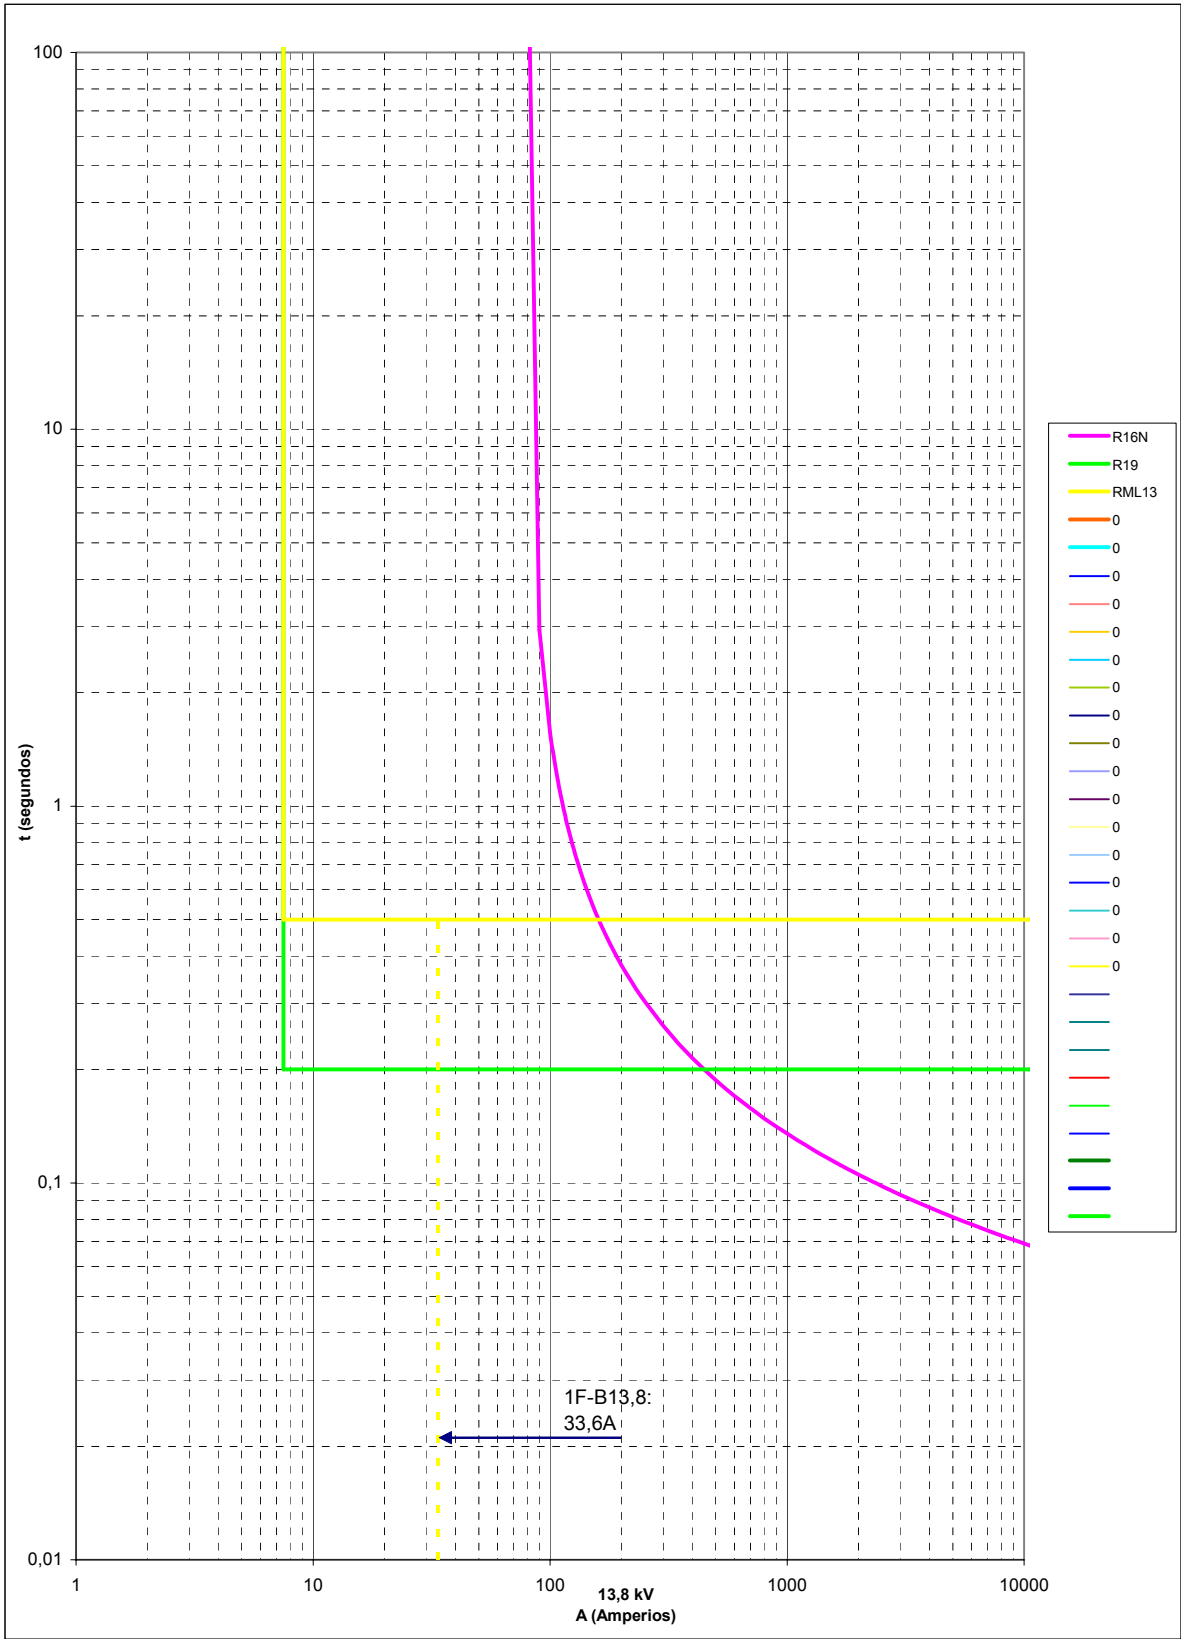

DESIG- NACIÓN	MARCA DEL RELÉ	TIPO	I _{N-Relé} (A)	CT (A)	KV		AJUSTES RELÉS					I _{NOM-FUS.} (A)	I _{CC} (A)	
					Nom.	Ref.	NORMA	CURVA	TAP	DIAL	INST		Máx.	Mín.
R16N	ALSTOM	KCGG140	5	800/5	13,8	13,8	IEC	NI	80	0,05				
R19	ALSTOM	MCGG 22	5	50/5	13,8	13,8		DT	7,5	0,2 s				
RML13	ALSTOM	MCGG 23	5	50/5	13,8	13,8		DT	7,5	0,2 s				