


SUBESTACION SOCABAYA 138/35,5 KV - TRANSFORMADORES TR1 y TR2

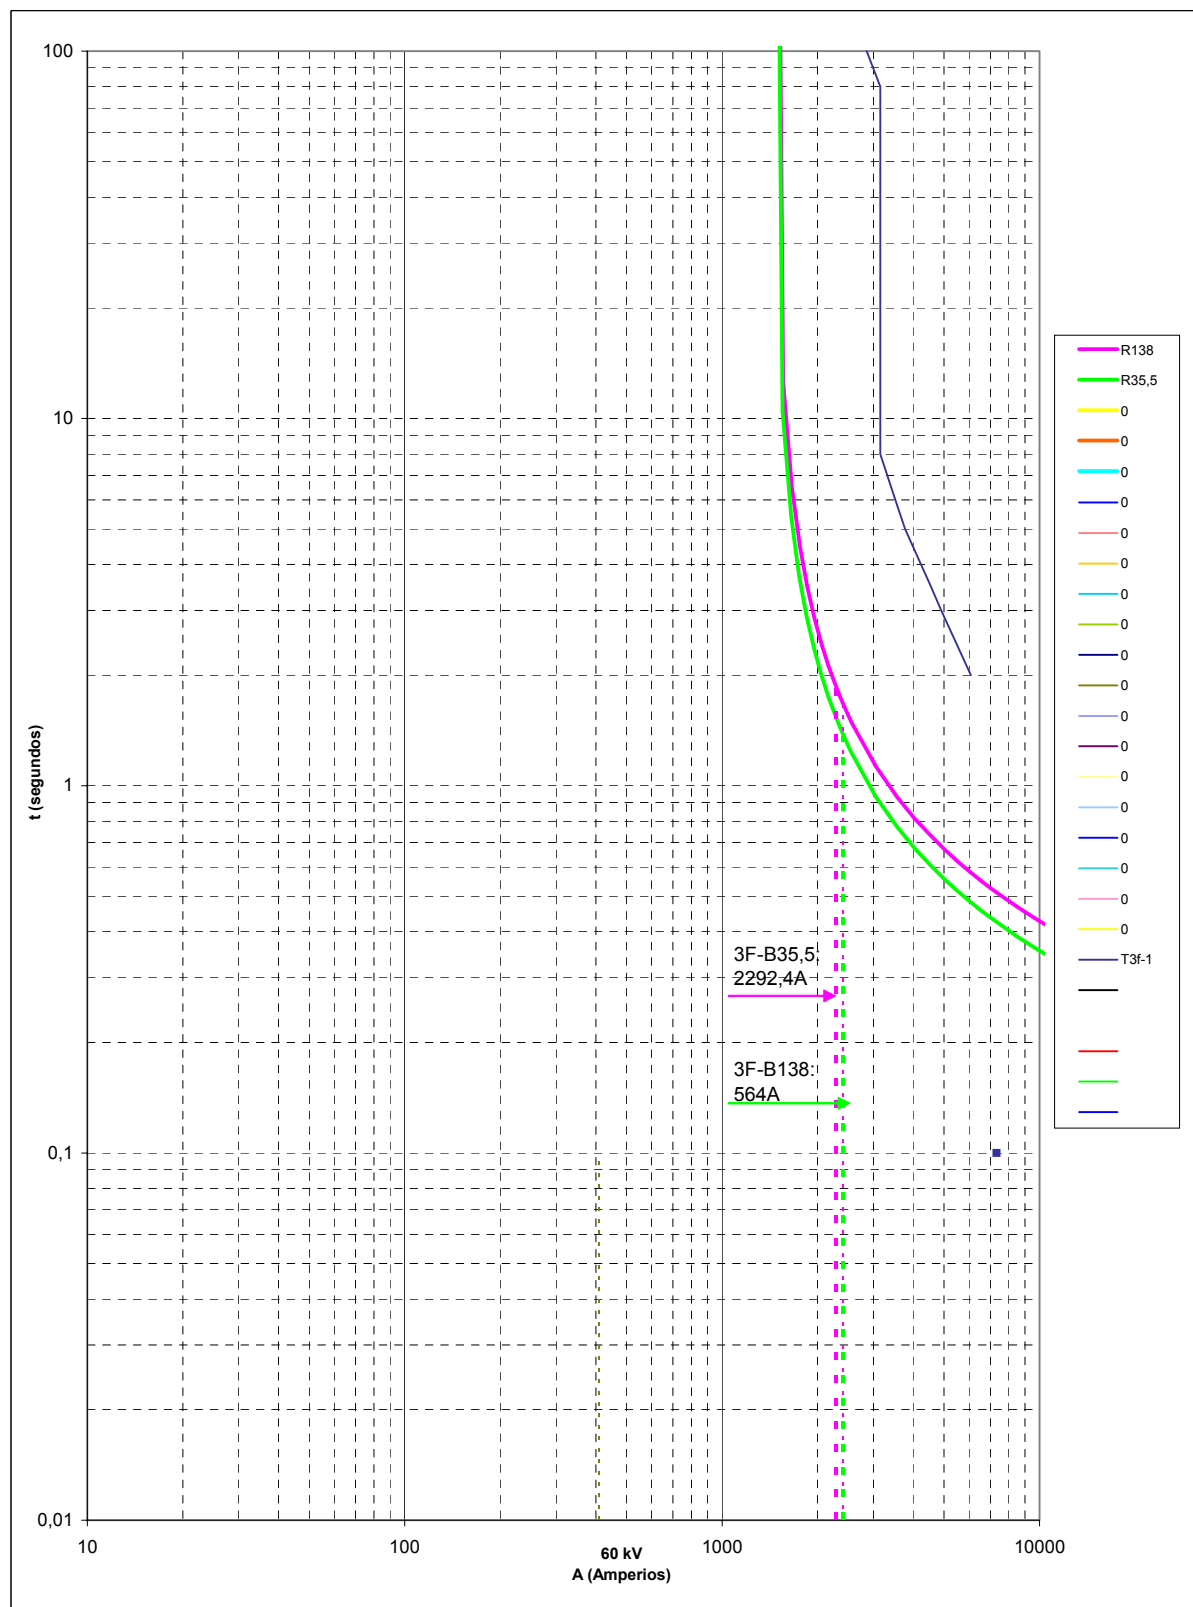

DESIGNACIÓN	MARCA DEL RELÉ	TIPO	I _{N-Relé} (A)	CT (A)	KV		AJUSTES RELÉS		UNID INST			I _{CC} (A)	
					Nom.	Ref.	NORMA	CURVA	TAP	DIAL	I>>	T>>(Seg)	Máx.
R138	ALSTOM	MAS 211-2	1	300/1	138	35.5	IEC	NI	375	0.12	3000		
R35.5	ALSTOM	MAS 211-2	5	1250/5	35.5	35.5	IEC	NI	1450	0.1			